



Hazen-Williams Pipe Flow Diagram
 for Hazen-Williams coefficient $C = 100$
 instructions in Figure 5.5(c) on page 168

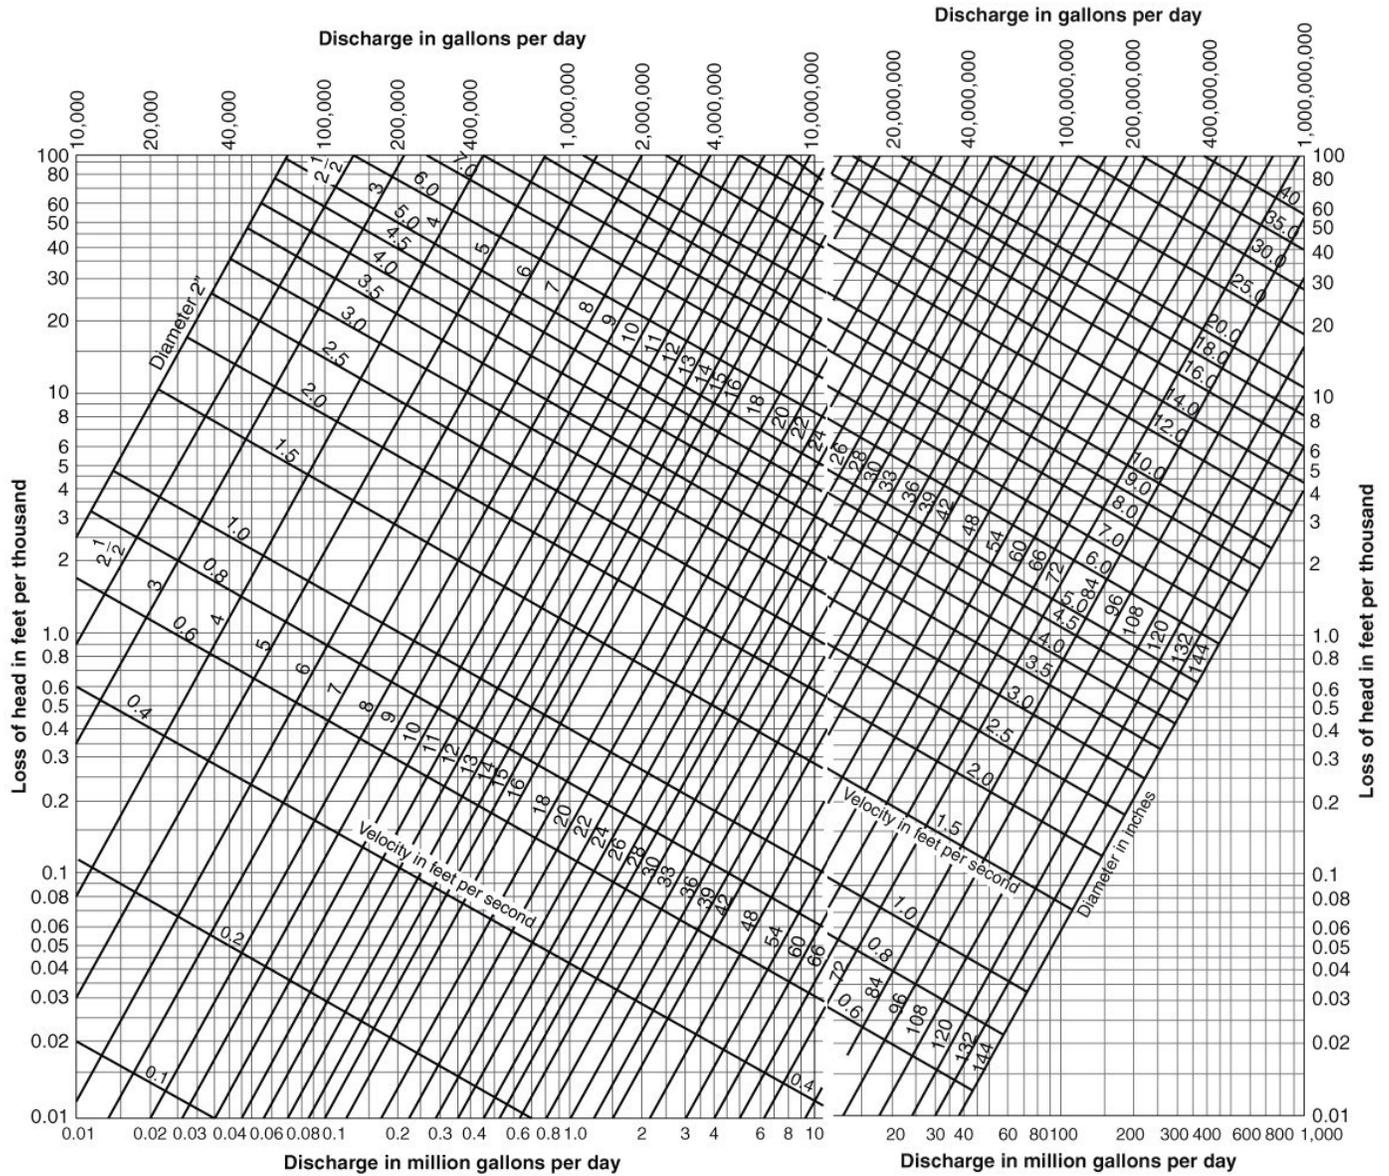


Figure 5.5a
 © John Wiley & Sons, Inc. All rights reserved.

Figure 5.5b
 © John Wiley & Sons, Inc. All rights reserved.

Shammas, N.K. and L.K. Wang (2011), *Water Supply and Wastewater Removal*, 3rd ed., John Wiley and Sons, Inc., Hoboken, NJ.



Hazen-Williams Pipe Flow Nomogram
for Hazen-Williams coefficient $C = 100$

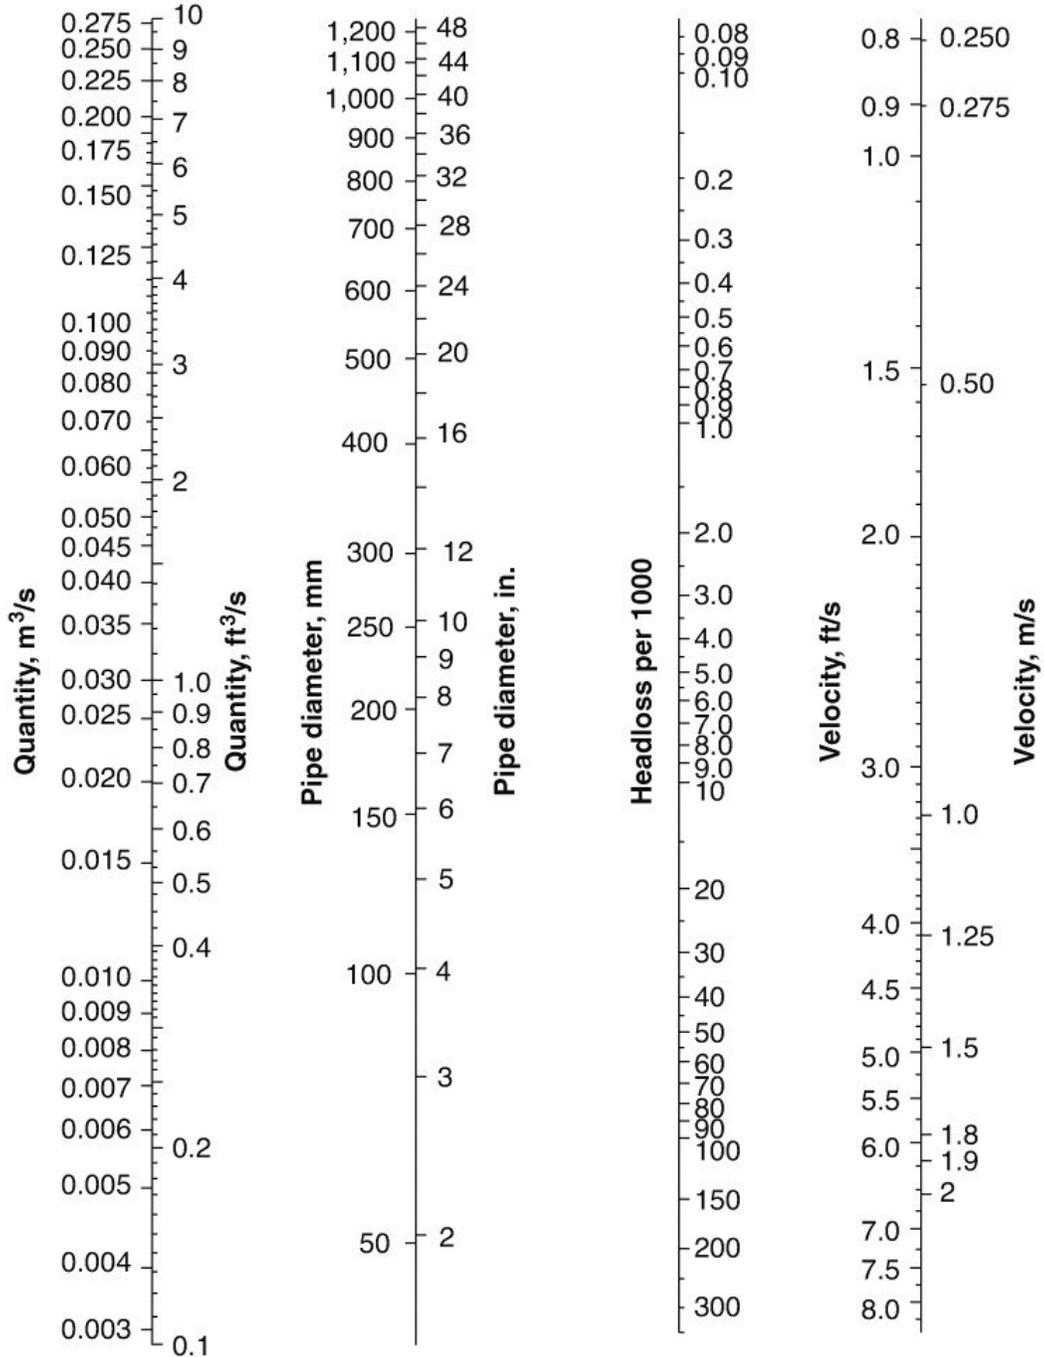


Figure 5.6
© John Wiley & Sons, Inc. All rights reserved.

Shammas, N.K. and L.K. Wang (2011), *Water Supply and Wastewater Removal*, 3rd ed., John Wiley and Sons, Inc., Hoboken, NJ.